




This drawing should not be relied on or used in circumstances other than those for which it was originally prepared and for which Mott MacDonald Sweco JV was commissioned. This drawing has been prepared for the titled project or named part thereof and should not be relied upon or used for any other project without an independent check being carried out as to its suitability and prior written authority of Mott MacDonald Sweco JV being obtained.

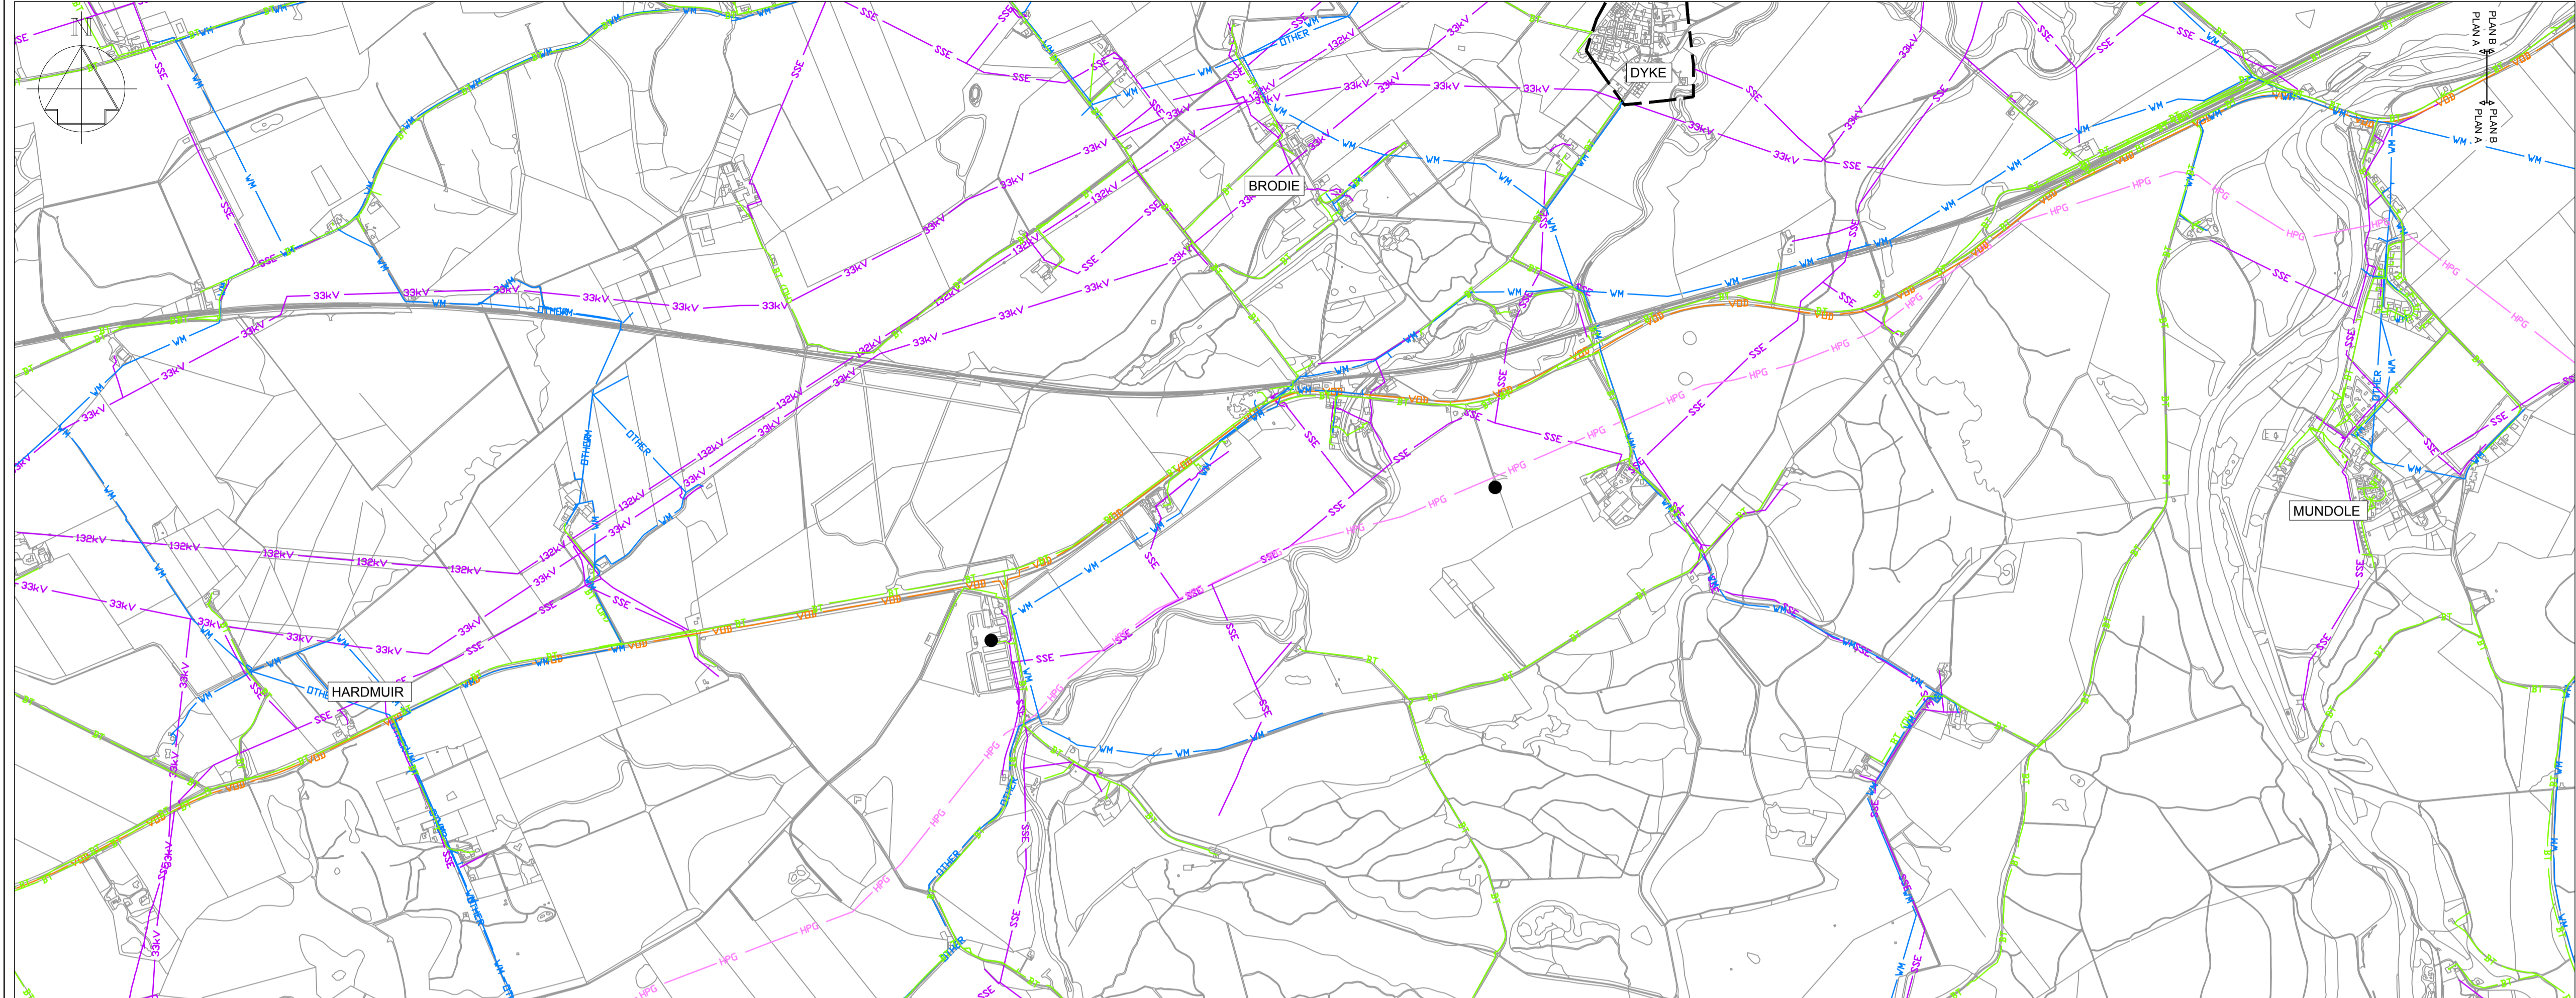

PLAN A - SCALE 1 : 12,500

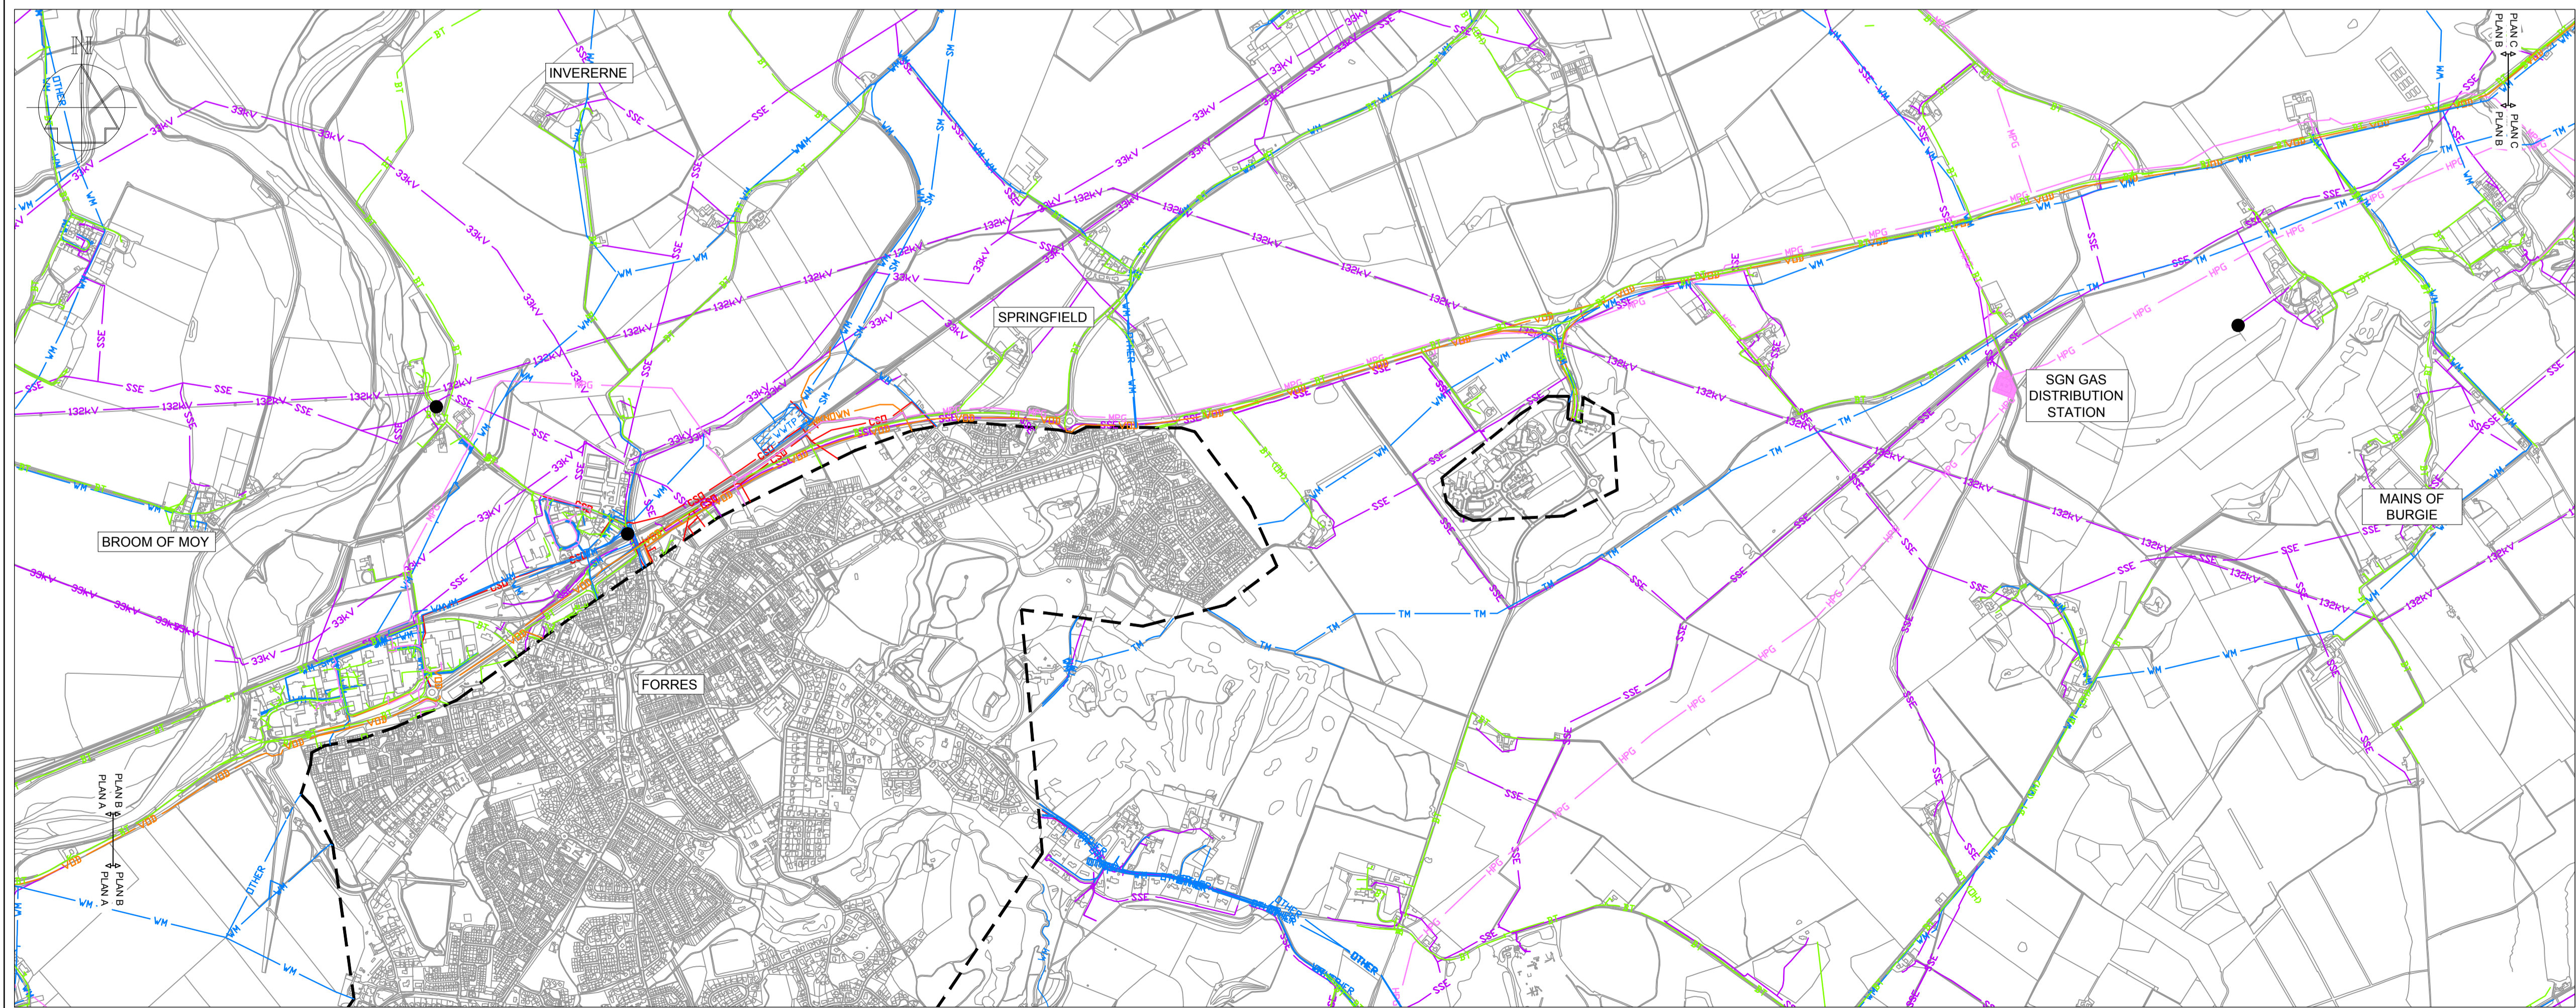

PLAN B - SCALE 1 : 12,500

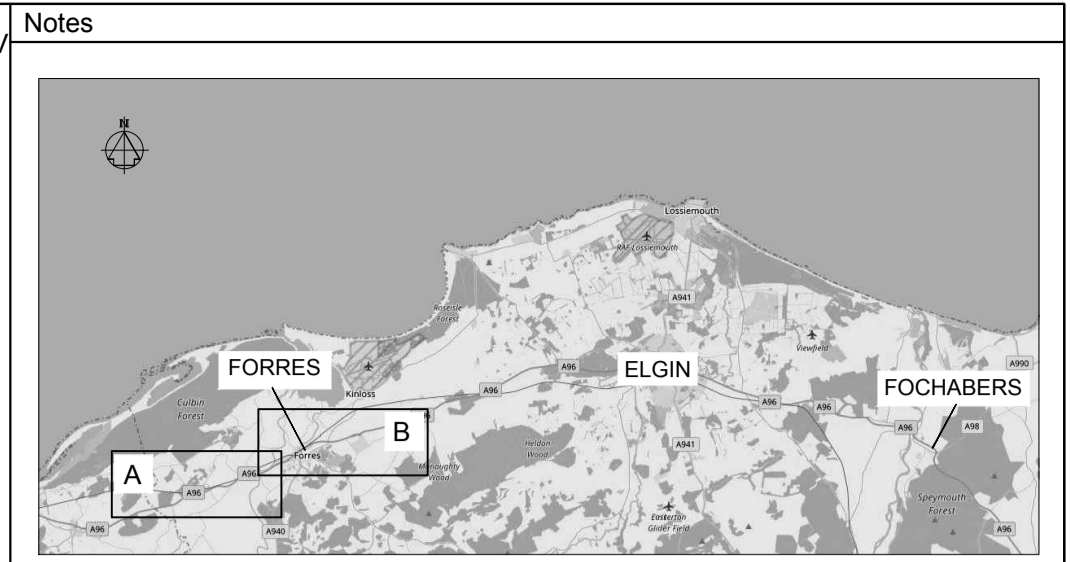

Key to symbols

	OVERHEAD BT CABLE
	UNDERGROUND BT CABLE
	INFERRED BT CABLE
	VODAFONE (THUS) CABLE
	LOW PRESSURE GAS MAIN
	MEDIUM PRESSURE GAS MAIN
	INTERMEDIATE PRESSURE GAS MAIN
	HIGH PRESSURE GAS MAIN
	COMBINED SEWER OUTFALL
	TRUNK WATER MAIN
	WATER MAIN
	SEWER MAIN
	UNKNOWN PIPELINE
	PFI SEWER
	OTHER MAIN
	SSE LINE
	33kV LINE
	132kV OVERHEAD LINES
	COMMUNICATION MASTS
	AREAS NOT INCLUDED WITHIN UTILITY SEARCH

P01	22/10/18	For Review and Comment	AR	BP	RL
P02	27/10/18	For Stage Approval	AR	BP	RL
C01	27/11/18	Approved as Stage Complete	DD	BP	RL
Rev	Date	Amendment Details	Orig	Chk'd	App'd

Mott MacDonald Sweco

Client:

Drawing Status: **Approved as Stage Complete** Subtitle: **A2**


Project Title: **A96 DUALLING HARDMUIR TO FOCHABERS**

Drawing Title: **FIGURE 2.14 EXISTING CONDITIONS - UTILITIES SHEET 1 OF 3**


Scale	As Shown	Designed	O'Carroll, Barry	Drawn	O'Carroll, Barry	Checked	Lyng, Ronan	Approved	Wallace, Steve
Original Size	A1	Date	14/08/18	Date	14/08/18	Date	14/08/18	Date	14/08/18
Drawing Number	A96PHF-MMS-GEN-20000-DR-D-00004								Project Ref. No. A96PHF
									Revision C01

TS PIN | Originator | Volume | Location | Type | Role | Number

This drawing should not be relied on or used in circumstances other than those for which it was originally prepared and for which Mott MacDonald Sweco JV was commissioned. This drawing has been prepared for the titled project or named part thereof and should not be relied upon or used for any other project without an independent check being carried out as to its suitability and prior written authority of Mott MacDonald Sweco JV being obtained.

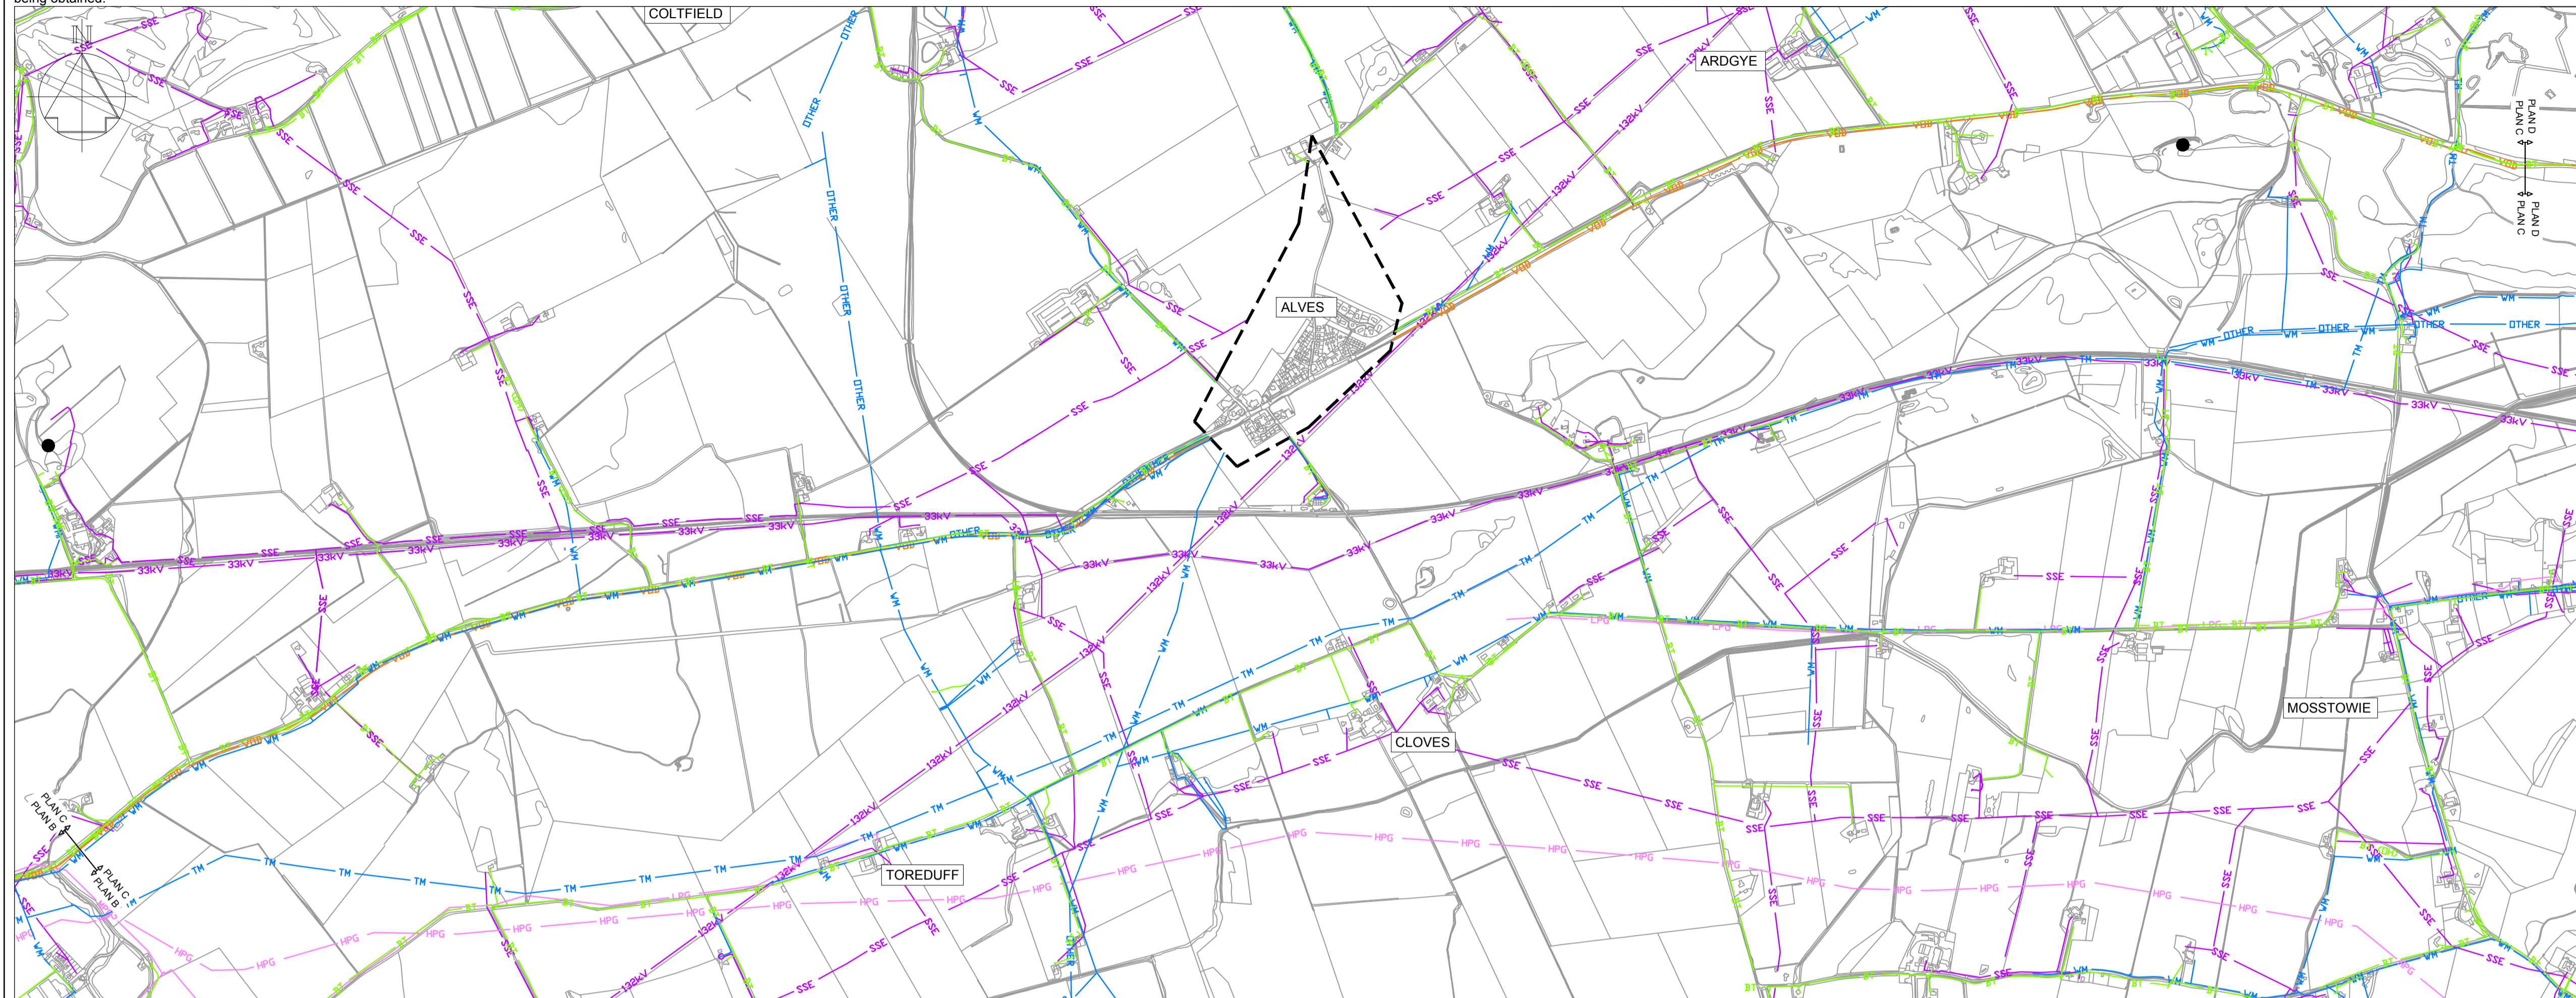

PLAN C - SCALE 1 : 12,500

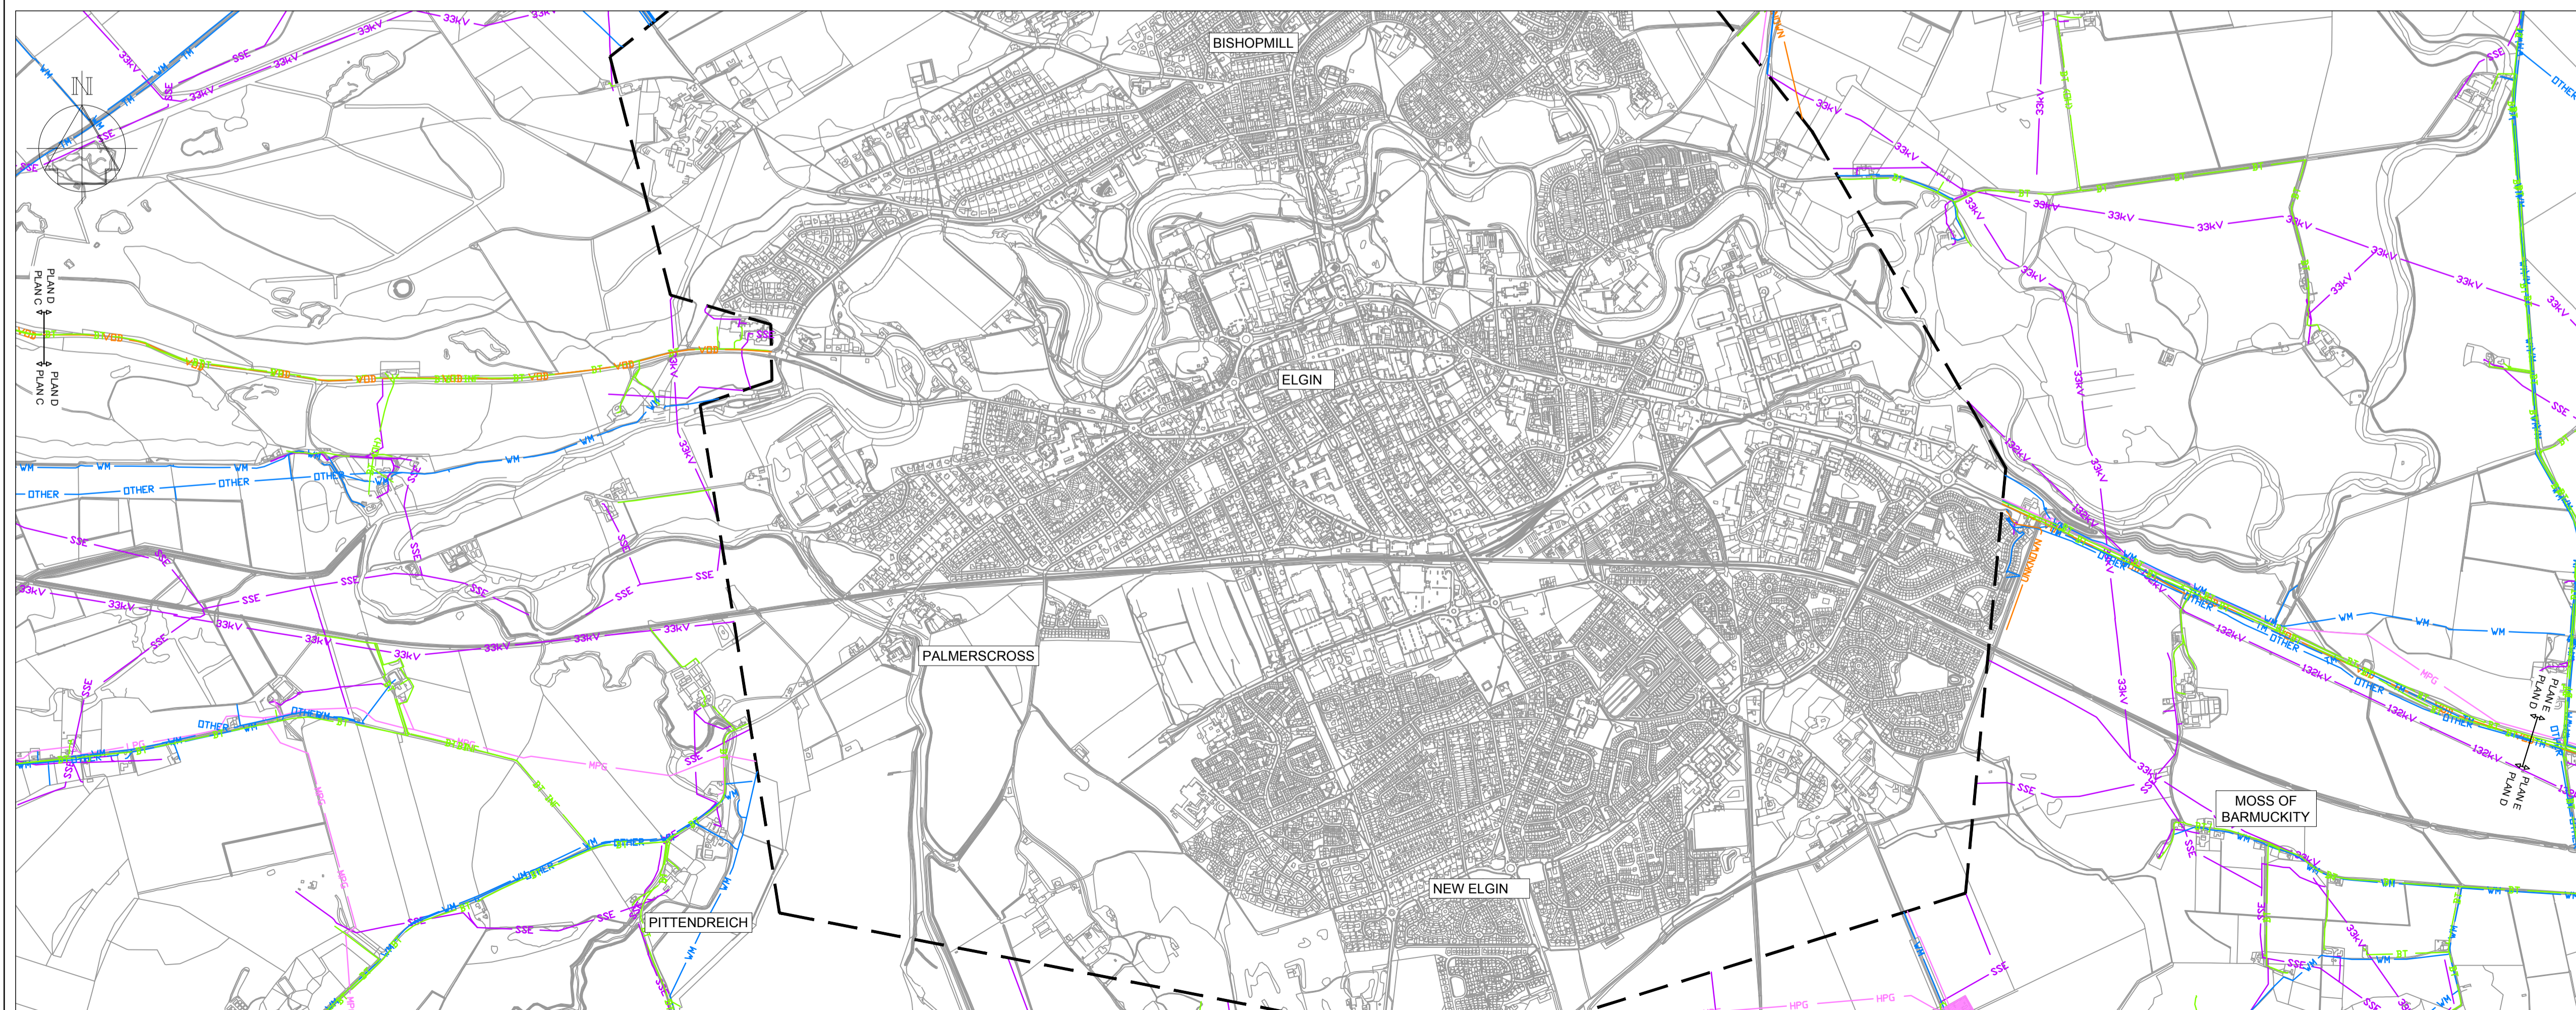

PLAN D - SCALE 1 : 12,500

Notes

Key to symbols

- BT GO — OVERHEAD BT CABLE
- BT — UNDERGROUND BT CABLE
- BT INF — INFERRED BT CABLE
- VOD — VODAFONE (THUS) CABLE
- LPM — LOW PRESSURE GAS MAIN
- MPM — MEDIUM PRESSURE GAS MAIN
- HPM — INTERMEDIATE PRESSURE GAS MAIN
- HPG — HIGH PRESSURE GAS MAIN
- CSO — COMBINED SEWER OUTFALL
- TM — TRUNK WATER MAIN
- WM — WATER MAIN
- SM — SEWER MAIN
- UNK — UNKNOWN PIPELINE
- PFI — PFI SEWER
- OTH — OTHER MAIN
- SSE — SSE LINE
- 33KV — 33KV LINE
- 132KV — 132KV OVERHEAD LINES
- COMMUNICATION MASTS
- AREAS NOT INCLUDED WITHIN UTILITY SEARCH

Rev	Date	Amendment Details	Orig	Chk'd	App'd
P01	22/10/18	For Review and Comment	CB	BP	RL
P02	27/10/18	For Stage Approval	CB	BP	RL
C01	27/11/18	Approved as Stage Complete	DD	BP	RL

Mott MacDonald Sweco

Client: **Transport Scotland** **A96 DUALLING HARDMUIR TO FOCHABERS**

Drawing Status: **Approved as Stage Complete** Subtitle: **A2**

Project Title: **A96 DUALLING HARDMUIR TO FOCHABERS**


Drawing Title: **FIGURE 2.15 EXISTING CONDITIONS - UTILITIES SHEET 2 OF 3**

Scale	Designed	Drawn	Checked	Approved
As Shown	O'Carroll, Barry	O'Carroll, Barry	Lyng, Ronan	Wallace, Steve
Original Size A1	Date 14/08/18	Date 14/08/18	Date 14/08/18	Date 14/08/18


Drawing Number: **A96PHF-MMS-GEN-20000-DR-D-00005** Project Ref. No: **A96PHF** Revision: **C01**

TS PIN | Originator | Volume | Location | Type | Role | Number


This drawing should not be relied on or used in circumstances other than those for which it was originally prepared and for which Mott MacDonald Sweco JV was commissioned. This drawing has been prepared for the titled project or named part thereof and should not be relied upon or used for any other project without an independent check being carried out as to its suitability and prior written authority of Mott MacDonald Sweco JV being obtained.

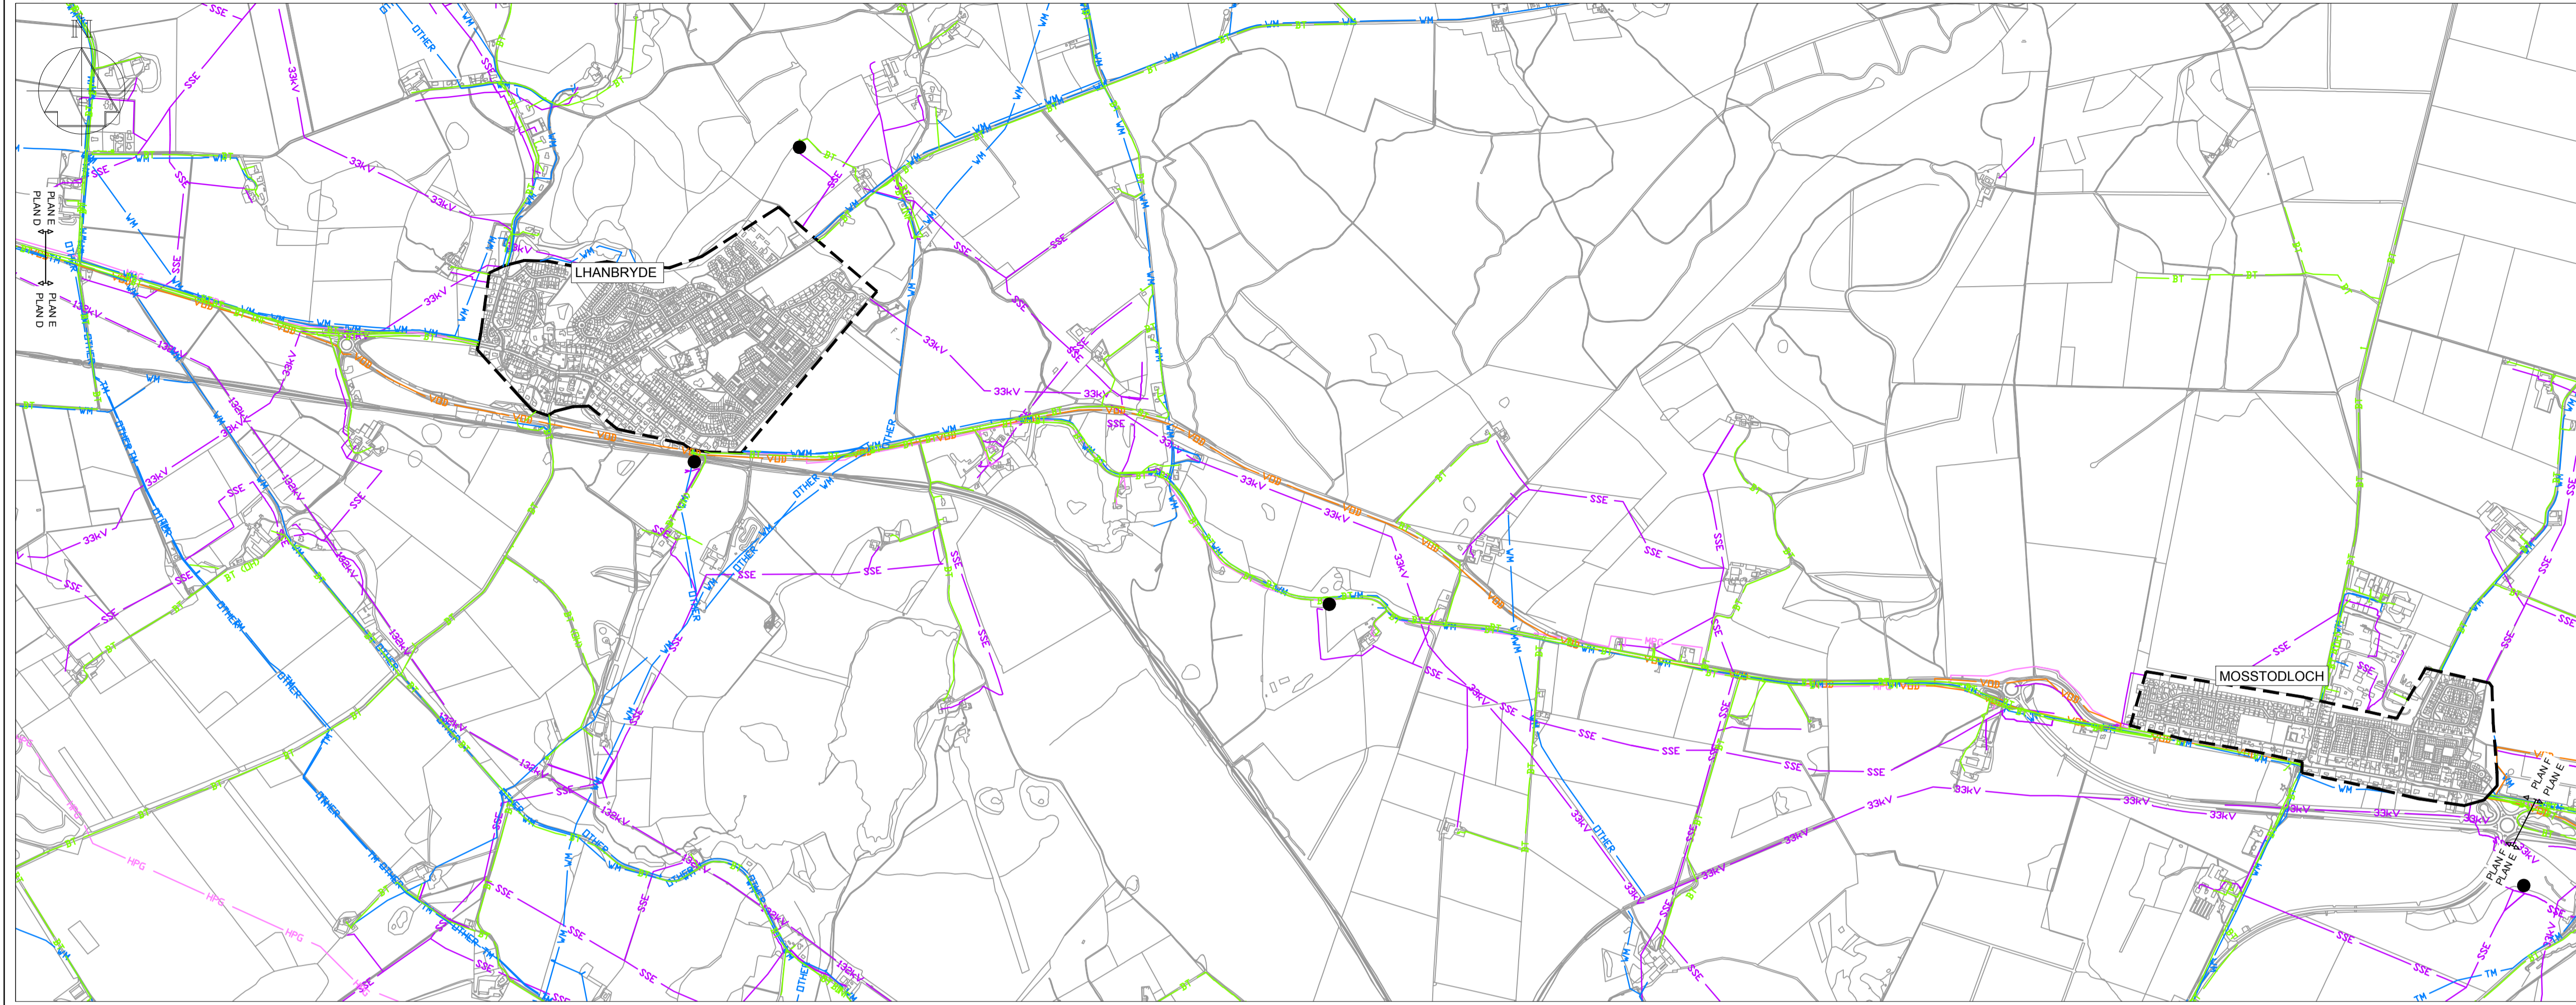

PLAN E - SCALE 1 : 12,500



PLAN F - SCALE 1 : 12,500

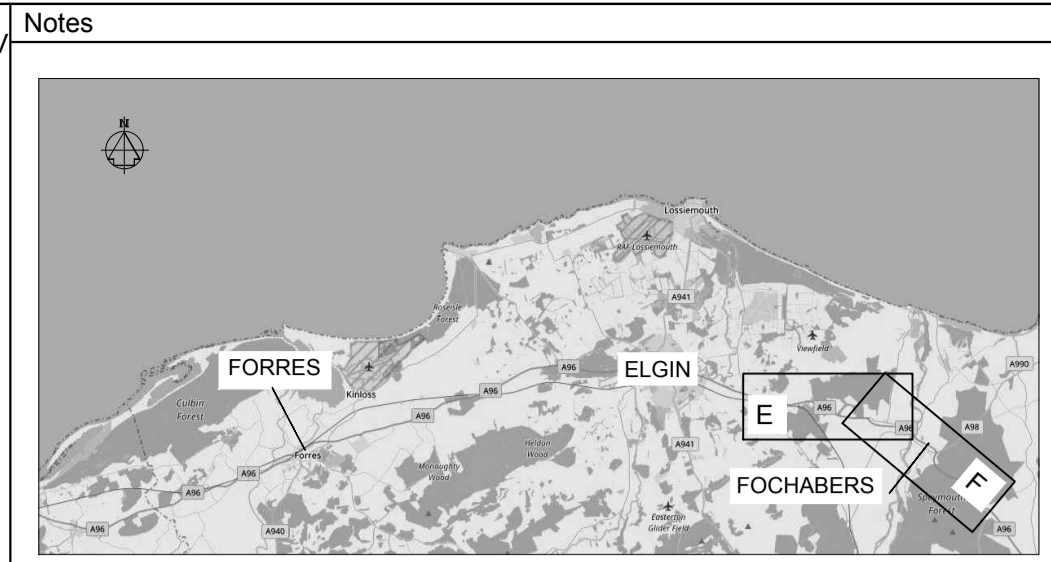

Key to symbols

	OVERHEAD BT CABLE
	UNDERGROUND BT CABLE
	INFERRED BT CABLE
	VODAFONE (THUS) CABLE
	LOW PRESSURE GAS MAIN
	MEDIUM PRESSURE GAS MAIN
	HIGH PRESSURE GAS MAIN
	COMBINED SEWER OUTFALL
	TRUNK WATER MAIN
	WATER MAIN
	SEWER MAIN
	UNKNOWN PIPELINE
	PFI SEWER
	OTHER MAIN
	SSE LINE
	33kV LINE
	132kV OVERHEAD LINES
	COMMUNICATION MASTS
	AREAS NOT INCLUDED WITHIN UTILITY SEARCH

P01	22/10/18	For Review and Comment	AR	BP	RL
P02	27/10/18	For Stage Approval	AR	BP	RL
C01	27/11/18	Approved as Stage Complete	DD	BP	RL
Rev	Date	Amendment Details	Orig	Chk'd	App'd

Mott MacDonald Sweco

Client:

Drawing Status: **Approved as Stage Complete** Subtitle: **A2**

Project Title: **A96 DUALLING HARDMUIR TO FOCHABERS**

Drawing Title: **FIGURE 2.16 EXISTING CONDITIONS - UTILITIES SHEET 3 OF 3**

Scale	As Shown	Designed	O'Carroll, Barry	Drawn	O'Carroll, Barry	Checked	Lyng, Ronan	Approved	Wallace, Carol	
Original Size	A1	Date	14/08/18	Date	14/08/18	Date	14/08/18	Date	14/08/18	
Drawing Number	A96PHF-MMS-GEN-20000-DR-D-00006								Project Ref. No.	A96PHF
									Revision	C01

TS PIN | Originator | Volume | Location | Type | Role | Number